

Recessed LED Downlight Instruction Leaflet

VJC
LIGHTING

DL3232/DL3233/DL3350



EN

Read this instruction carefully before commencing installation and keep it for future reference.


Always switch off the mains before installation or maintenance.

Keep the product far from heat sources and in a well ventilated area.


The installation or maintenance should be carried out by a qualified electrician.




The light source contained in this luminaire shall only be replaced by the manufacturer or his service agent or a similar qualified person.



Cutout: 100*100mm
5-25mm




Cutout: 190*100mm
5-25mm

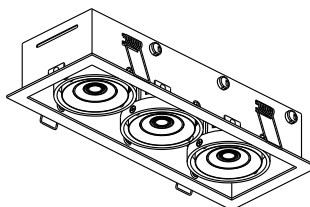


Cutout: 280*100mm
5-25mm


01

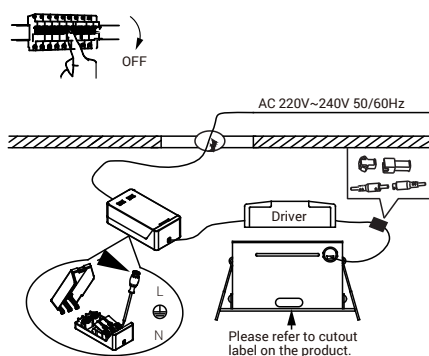


02

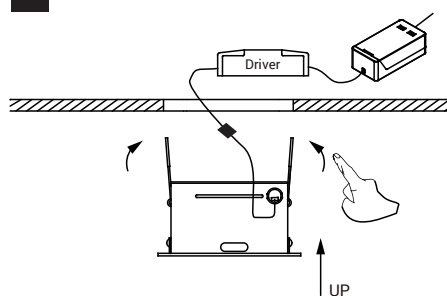

03



04

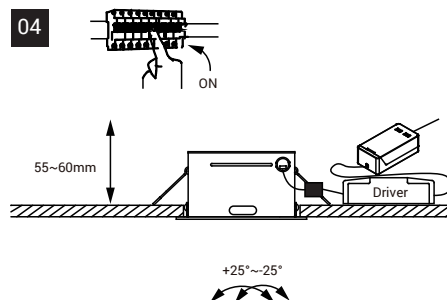


USERS GUIDE


SLK 3/5 Linect Quick Terminal Box

QT002 3/5 Linect

01

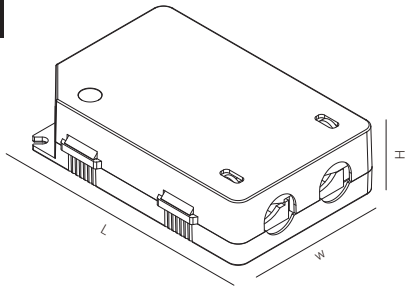

Material: Polypropylene with fire self-distinguishing
Dimension(L*W*H): 89*60*23mm

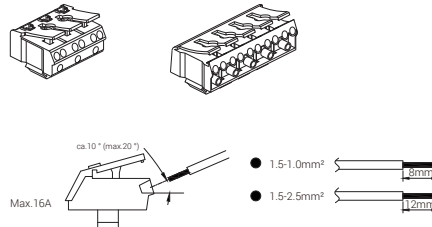


Suitable for use with screwless terminals from ELECTRO TERMINAL:

- ▶ SLK 3
- ▶ SLK 3 LINECT
- ▶ SLK 3/5
- ▶ SLK 3/5 LINECT

Compatible with all linect approved connection systems (www.li-nect.com)

02

CONNECT
with Li-nect Devices

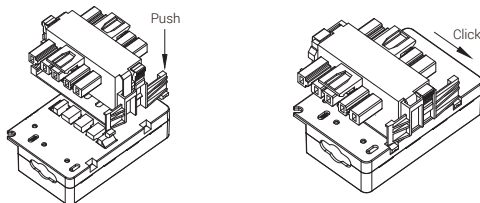

03

CONNECT
with Normal Cabling

